



PLAN SCHEMATIC

NOTES:

1. PRV REQUIRED FOR LINE PRESSURES >80 PSI.
2. THERMAL EXPANSION MUST BE PROVIDED FOR BY ADDITION OF AN EXPANSION TANK OR AN APPROVED PRESSURE RELIEF VALVE WITH A MAXIMUM SETTING OF 100 PSI OR LESS.
3. REQUIRES INITIAL AND ANNUAL CROSS CONNECTION TEST, AS PRESCRIBED IN CURRENT PLUMBING CODE AND/OR APPROVED ALTERNATE.

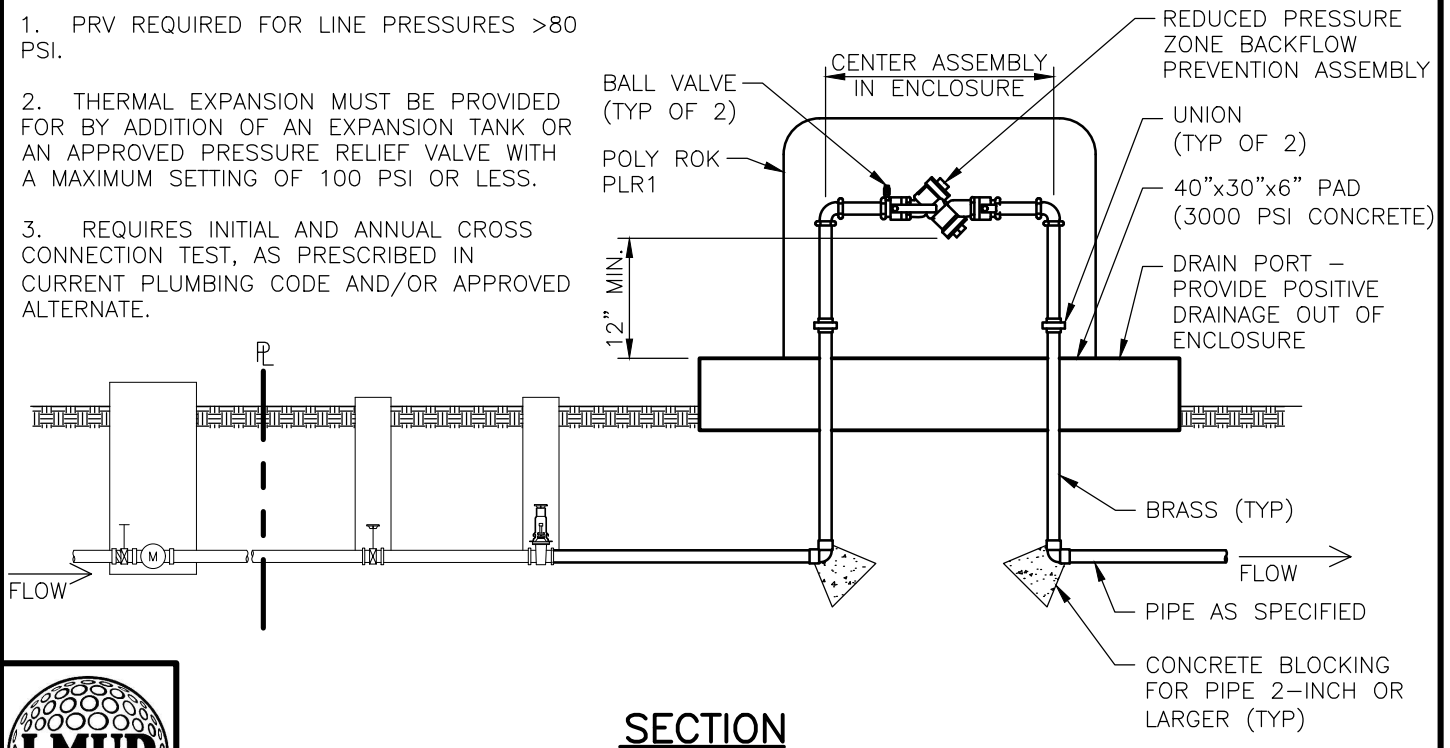

SECTION

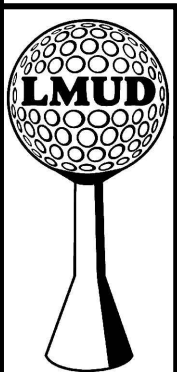

LAKWAY MUNICIPAL UTILITY DISTRICT LAKWAY, TEXAS

Scale: NTS			
Date Issued: NOVEMBER 28, 2022			
Rev.#	Date	By	Remarks

**POTABLE WATER SERVICE
WITH RECLAIMED WATER
IRRIGATION**

**STANDARD
DETAIL
WR-1**